
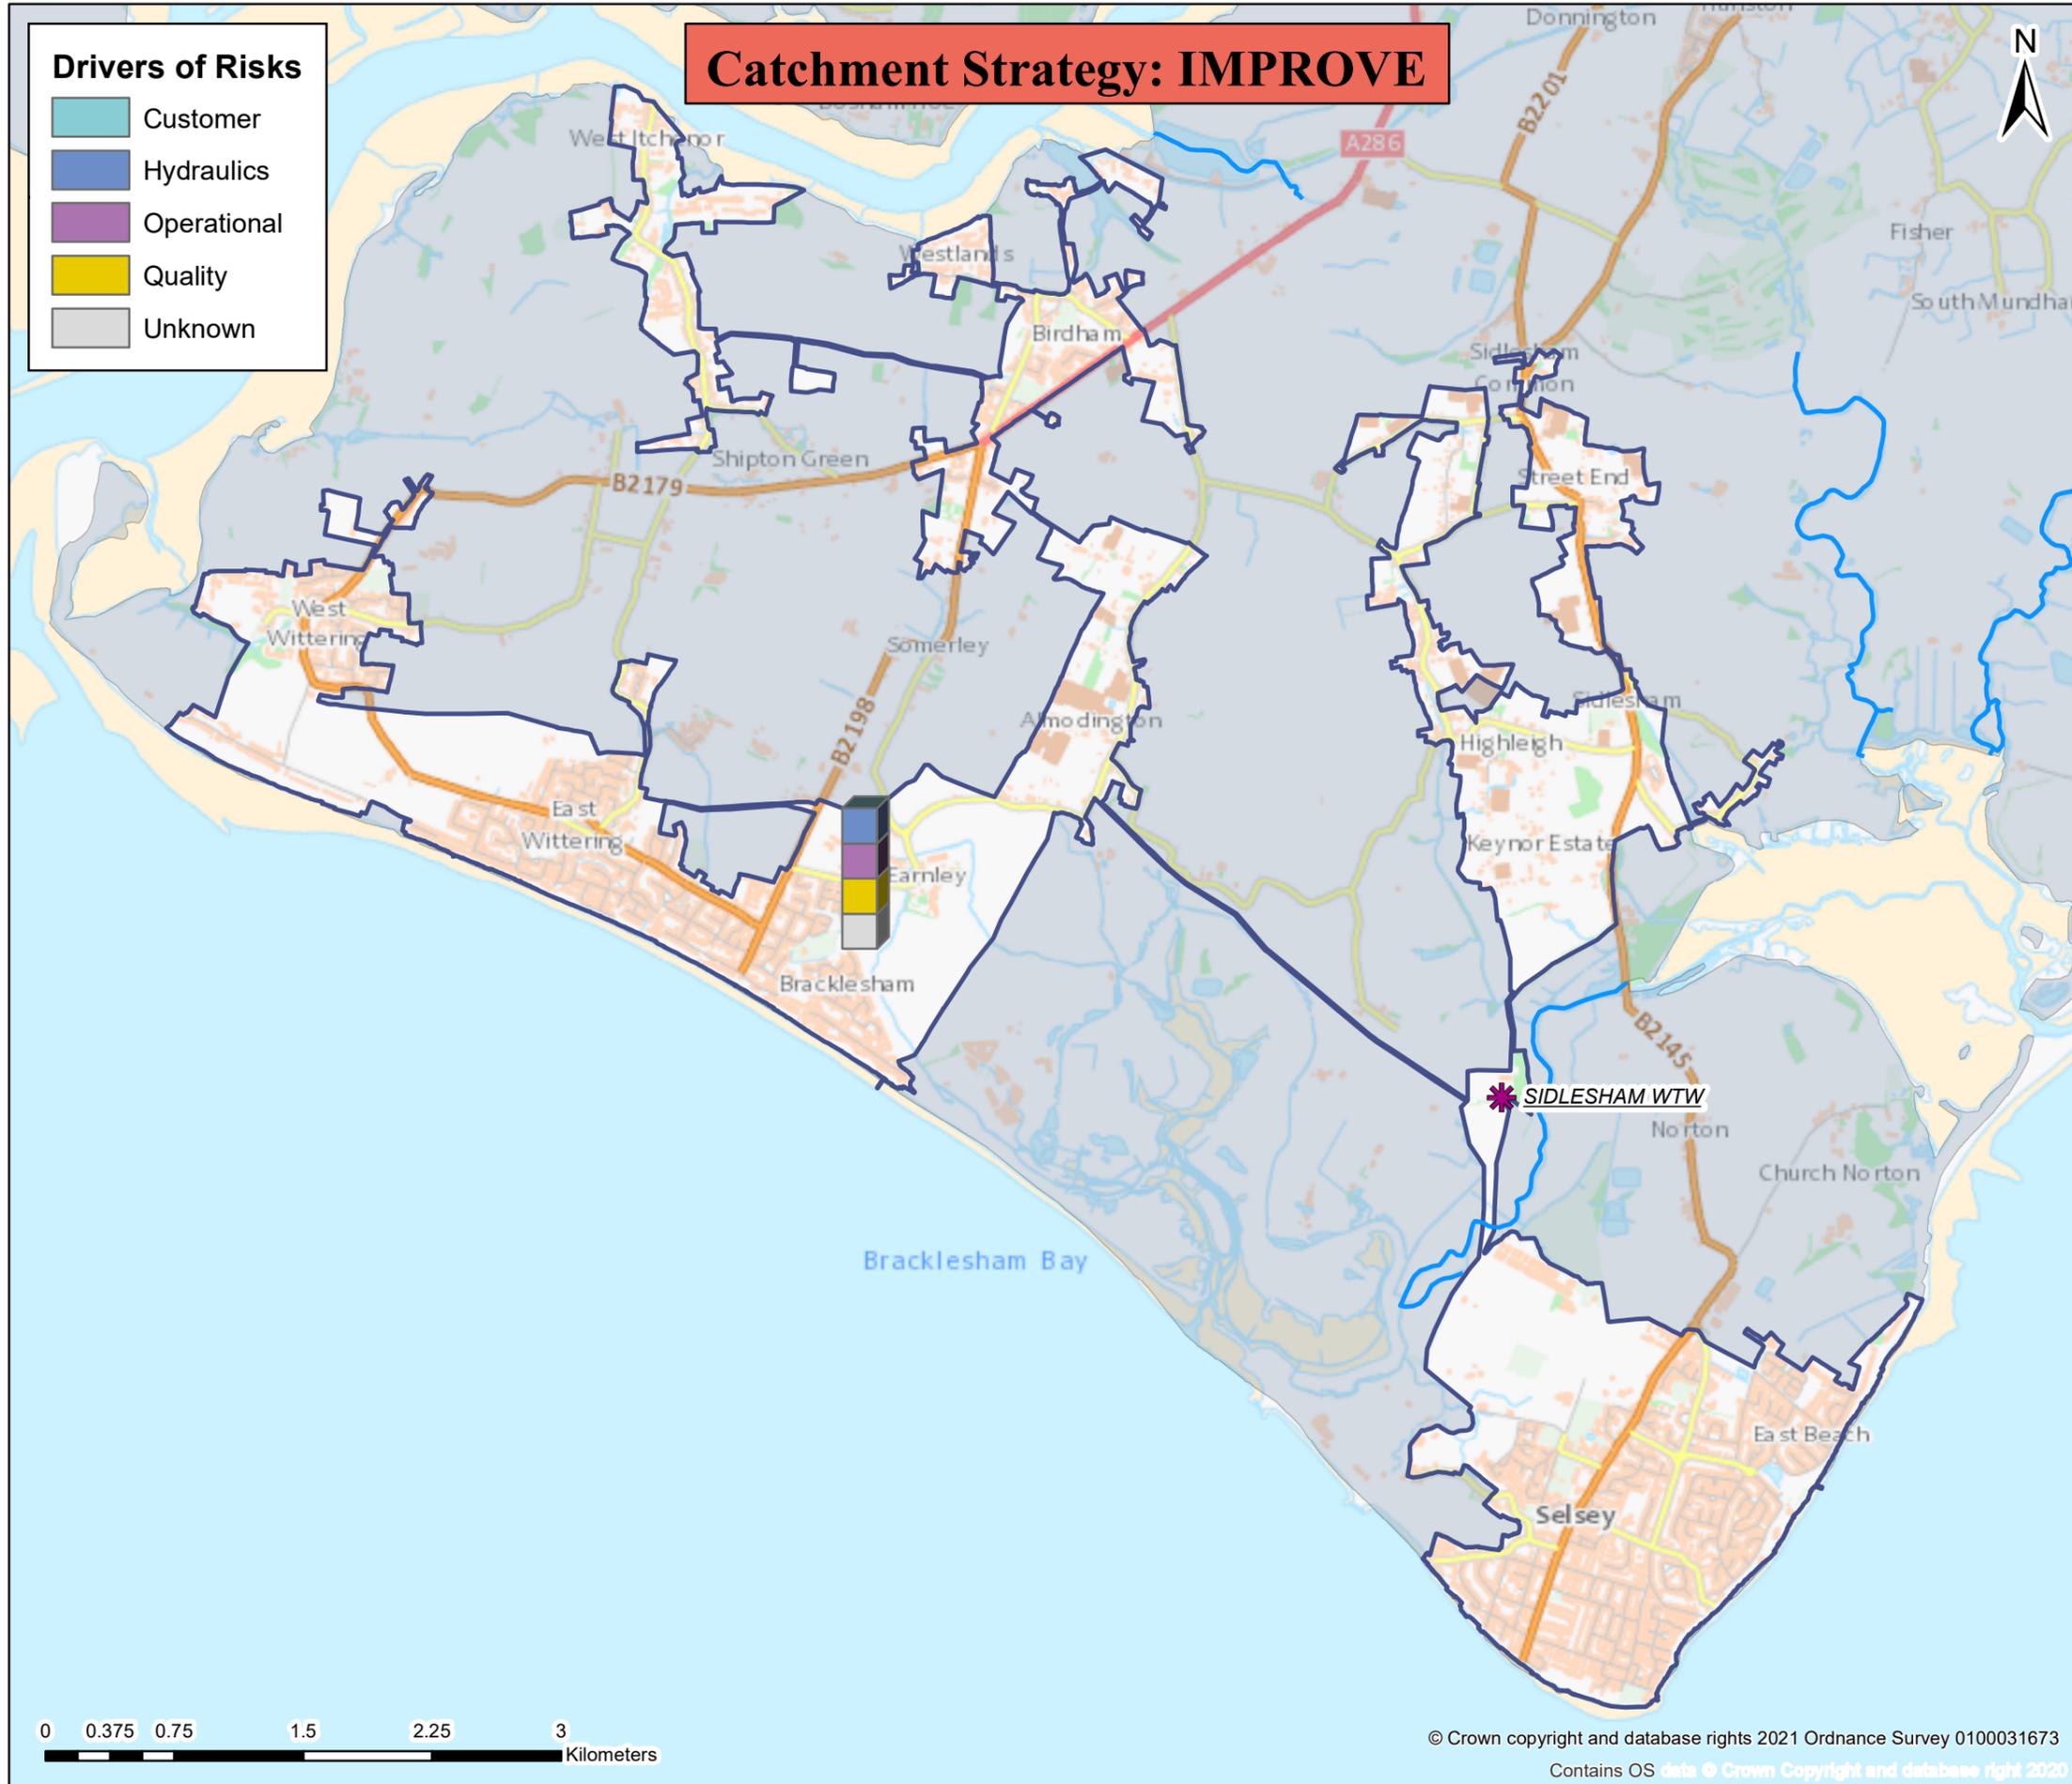


# Sidlesham wastewater system: map and key facts

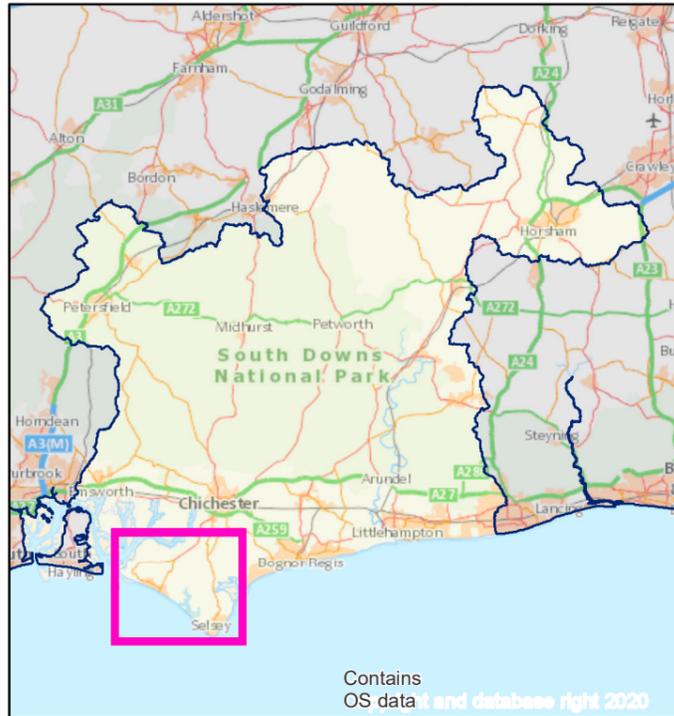

<b>Population Equivalent (PE)</b>	<b>25,167</b>
<b>Discharge Waterbody</b>	<b>Broad Rife</b>
<b>Number of Pumping Stations</b>	<b>48</b>
<b>Number of Overflows</b>	<b>4</b>
<b>Length of Sewer (km)</b>	<b>272.7</b>
<b>Catchment Reference</b>	<b>SIDL</b>

BRAVA Results Table (SIDL)		
Planning Objective	2020	2050
1 Internal Sewer Flooding Risk	1	
2 Pollution Risk	1	
3 Sewer Collapse Risk	1	
4 Risk of Sewer Flooding in a 1 in 50 year storm	2	2
5 Storm Overflow performance	2	2
6 Risk of WTW Compliance Failure	0	0
7 Risk of flooding due to Hydraulic Overload	1	2
8 Dry Weather Flow Compliance	1	2
9 Good Ecological Status / Potential	0	
10 Surface Water Management	0	
11 Nutrient Neutrality	2	2
12 Groundwater Pollution	0	
13 Bathing Waters	0	
14 Shellfish Waters	NA	